


**MONTGOMERY COUNTY PUBLIC SERVICE AUTHORITY
WATER AND SEWER DESIGN & CONSTRUCTION STANDARDS
FOURTH EDITION
JULY 2018**

SECTION FOUR - LIST OF WATER DETAIL DRAWINGS

<u>W#</u>	<u>Title</u>
01	Single Residential Water Service
02	Single Residential Service for High Pressure (Line Pressure over 120 psi)
03	Single Residential Service with PRV (Line Pressure of 80 to 120 psi)
04	Commercial Water Service
05	Double Residential Water Service
06	Typical Sewer Subtraction Meter Configuration
07	Sewer Subtraction Meter Installation
08	Water Line Valve Installation
09	Permanent End of Line
10	Blow-Off Assembly for Main Line Temporary Termination
11	In-Line Blow-Off Assembly
12	Automatic Air Release Assembly
13	Automatic Air Release Assembly for Deep Water Lines
14	Main Line Pressure-Reducing Valve Assembly
15	Alternate Valve Vault (Manhole)
16	Installation Detail for All Frames and Covers
17	Manhole Frame and Cover
18	Fire Hydrant Assembly
19	Thrust Block Construction
20	Thrust Restraint of Pipe Joints Design Lengths
21	Typical Water Pressure Test Rig
22	Pipe Support in Casing Pipe

1. YOKE BAR TO BE Y-502 FORD OR APPROVED EQUAL.
2. SADDLES MUST BE USED WITH ALL PIPE.
3. METER BOX MUST BE CARSON 2200-18 WITH CAST IRON LID OR APPROVED EQUAL.

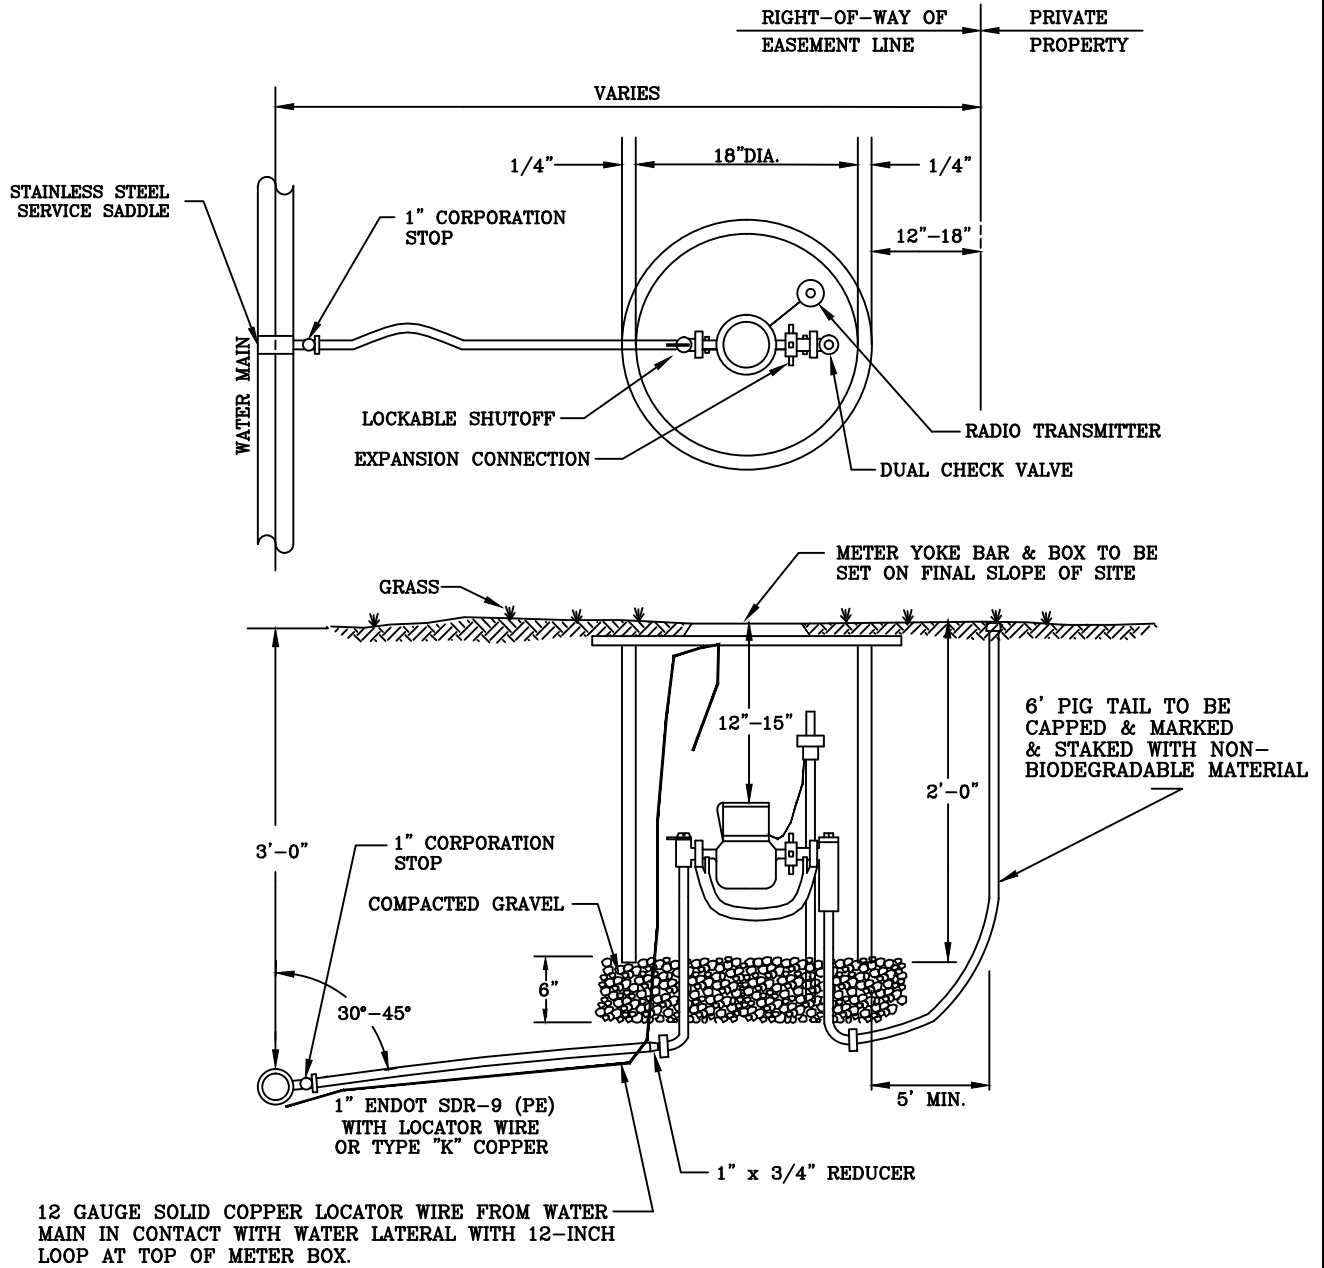


REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	07/25/12		


SINGLE RESIDENTIAL
 WATER SERVICE

DRAWING
W-01

- 1) SETTER TO BE FORD TVBHH72-9W-1133 OR APPROVED EQUAL.
- 2) PRESSURE REDUCING VALVE TO BE WILKINS NR3XLEC OR APPROVED EQUAL.
- 3) S BAR TO BE ST-2-31084-01 WITH PRV OR APPROVED EQUAL.
- 4) METER BOX MUST BE CARSON 2200-18 WITH CAST IRON LID OR APPROVED EQUIVALENT.
- 5) THIS CONFIGURATION IS REQUIRED WHEN THE WATER PRESSURE AT THE WATER MAIN EXCEEDS 120 PSI.
- 6) PRESSURE REDUCING VALVE SHALL BE INSTALLED ON PUBLIC WATER SYSTEM SIDE OF SETTER BEFORE WATER METER.

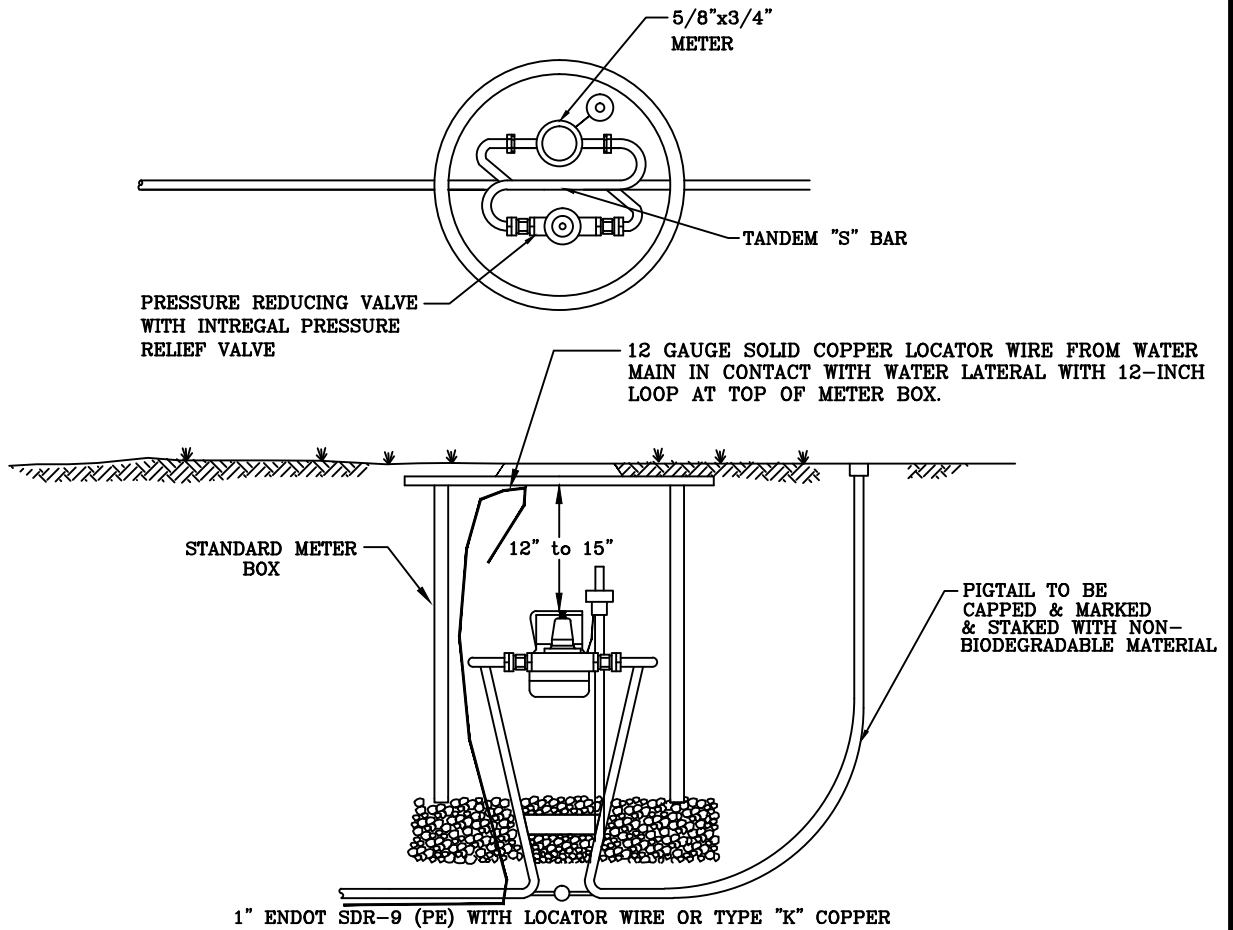


REVISIONS		SINGLE RESIDENTIAL SERVICE FOR HIGH PRESSURE (LINE PRESSURE OVER 120 PSI)	DRAWING	
NO.	DATE		W-02	
ORIGINAL	12/01/06			
1	07/25/12			
2	07/17/18			

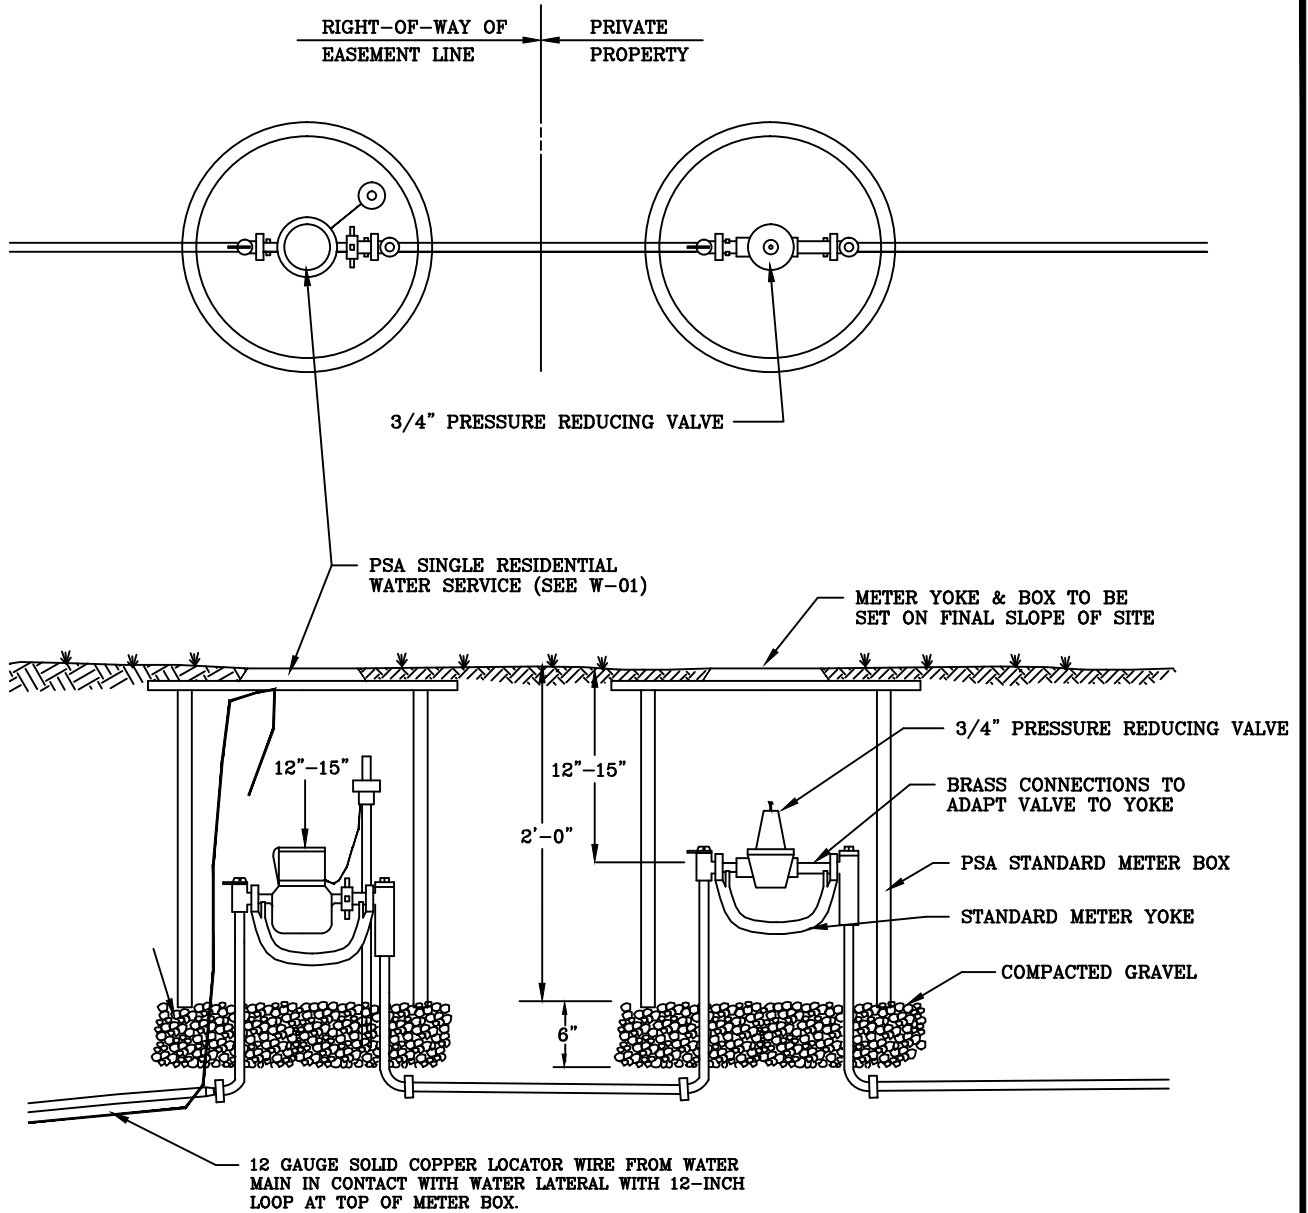


1) THIS CONFIGURATION REQUIRED WHEN WATER PRESSURE AT THE WATER MAIN IS BETWEEN 80 AND 120 PSI.

REVISIONS		SINGLE RESIDENTIAL WATER SERVICE WITH PRV (LINE PRESSURE OF 80 TO 120 PSI)	DRAWING	
NO.	DATE		W-03	
ORIGINAL	12/01/06			
1	09/01/07			
2	07/25/12			

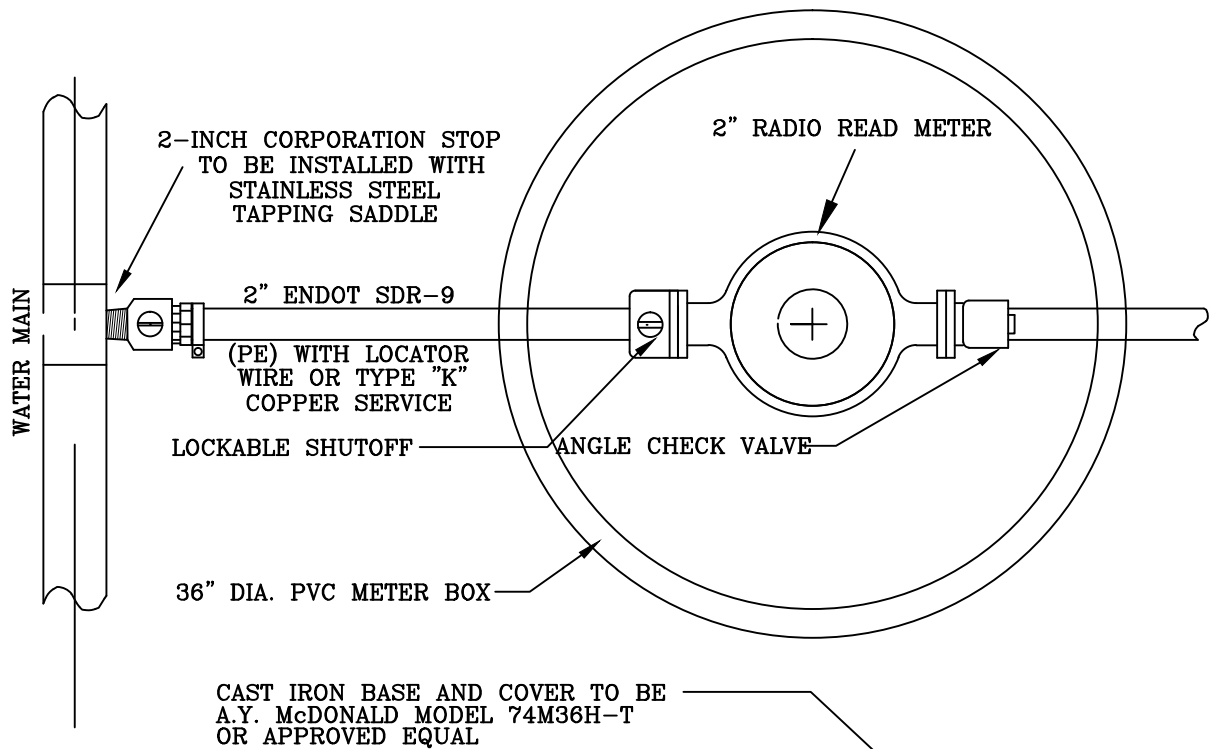

CAST IRON BASE AND COVER TO BE
 A.Y. McDONALD MODEL 74M36H-T
 OR APPROVED EQUAL

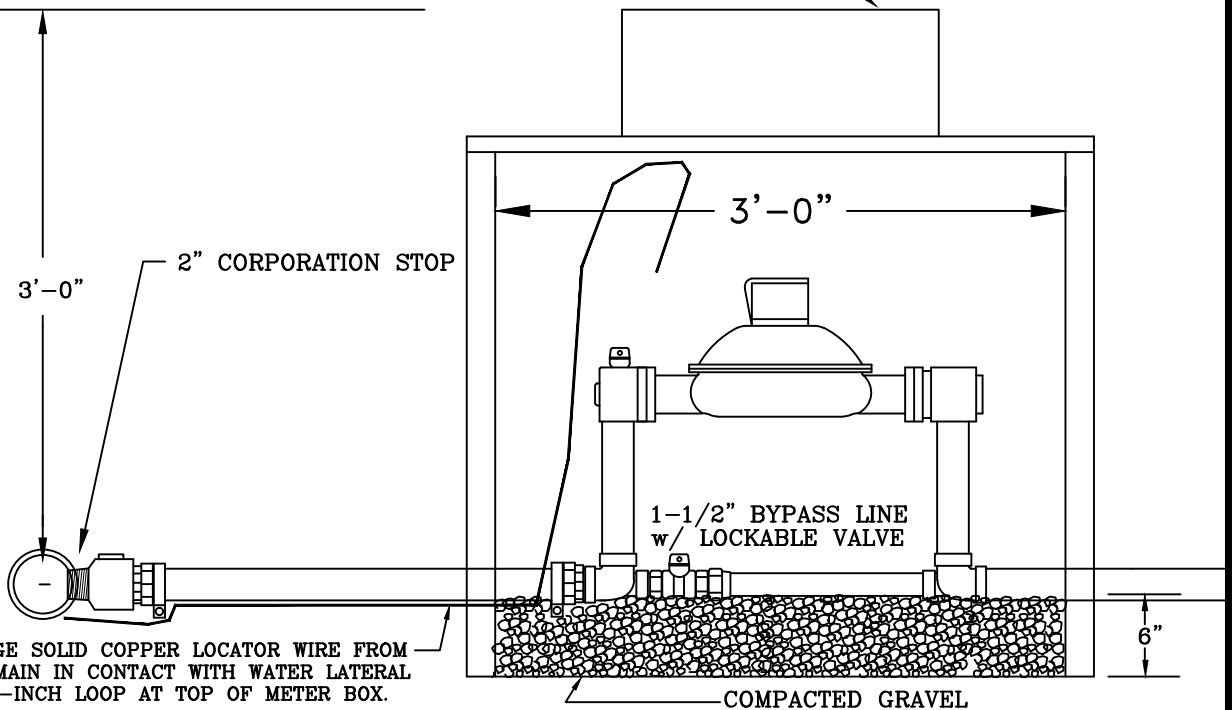


12 GAUGE SOLID COPPER LOCATOR WIRE FROM
 WATER MAIN IN CONTACT WITH WATER LATERAL
 WITH 12-INCH LOOP AT TOP OF METER BOX.

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	5/01/12		

COMMERCIAL
 WATER SERVICE

DRAWING
 W-04

1. SETTER TO BE A.Y. McDONALD #20-215 WDLL33 OR APPROVED EQUAL.
2. SADDLES MUST BE USED WITH ALL PIPE.
3. METER BOX MUST BE CARSON 2200-18 WITH CAST IRON LID OR APPROVED EQUAL.

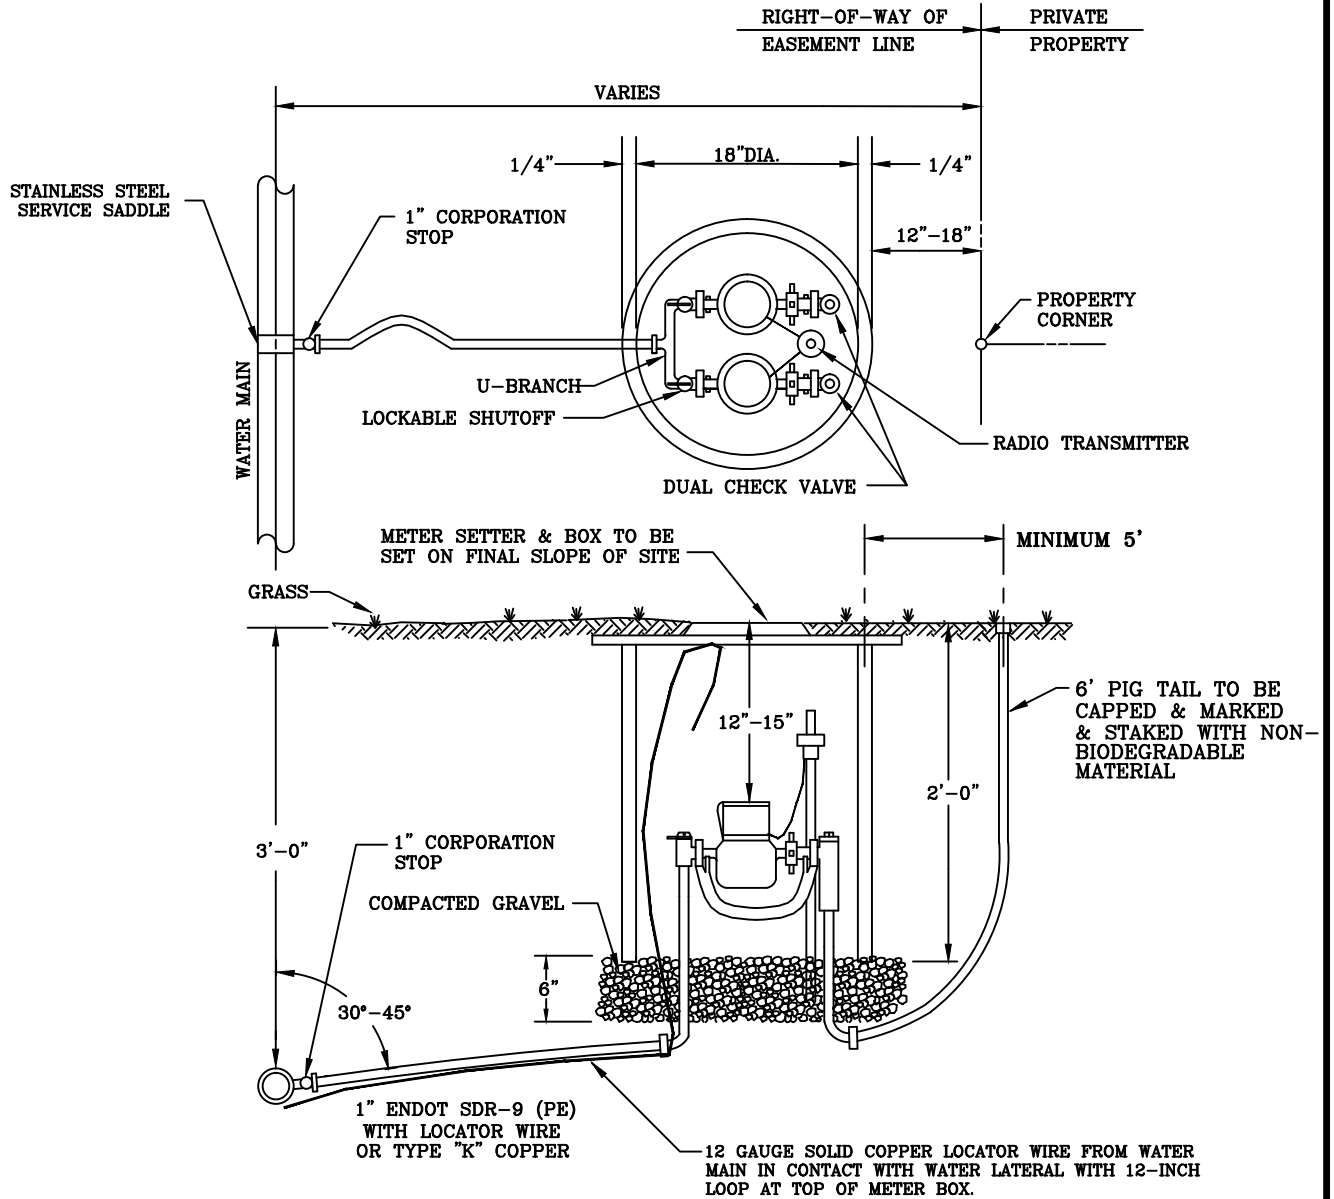


REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	07/25/12		



DOUBLE RESIDENTIAL
 WATER SERVICE

DRAWING
W-05

- 1) YOKE TO BE Y-502 FORD OR APPROVED EQUAL.
- 2) BACKFLOW PREVENTER TO BE RPZ MEETING ASSE STANDARD 1013.
- 3) CUSTOMER IS RESPONSIBLE FOR OPERATION AND MAINTENANCE OF BACKFLOW PREVENTER.
- 4) METER BOX MUST BE CARSON 2200-18 WITH CAST IRON LID OR APPROVED EQUAL.
- 5) METER SHALL BE CURRENT PSA MODEL WITH RADIO-READ UNIT

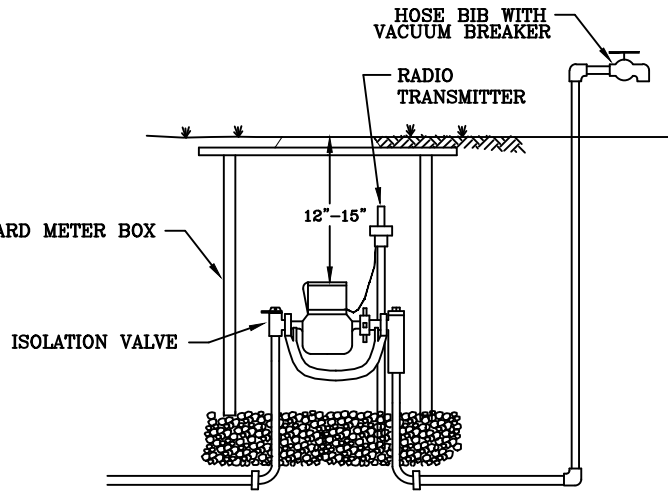


ALTERNATE CONFIGURATION FOR LIMITED USE

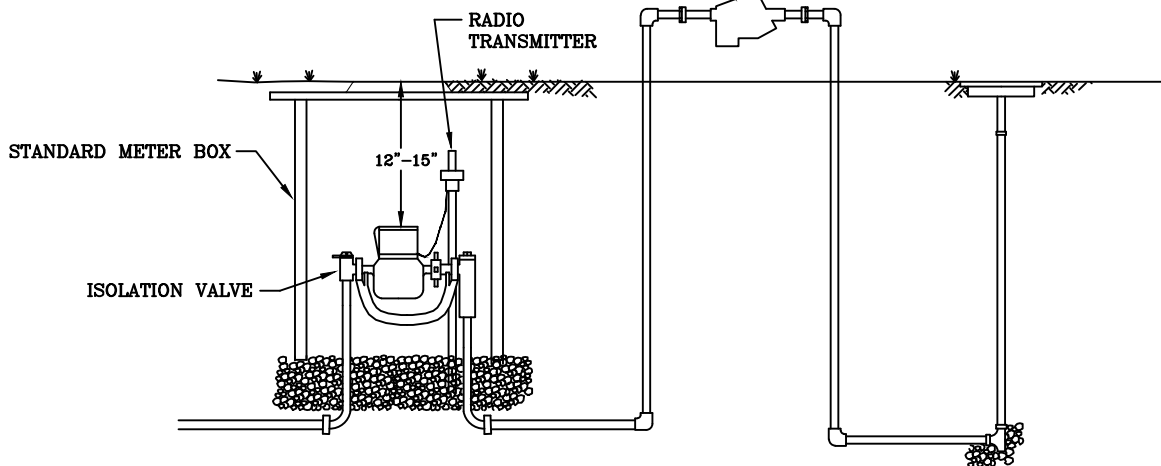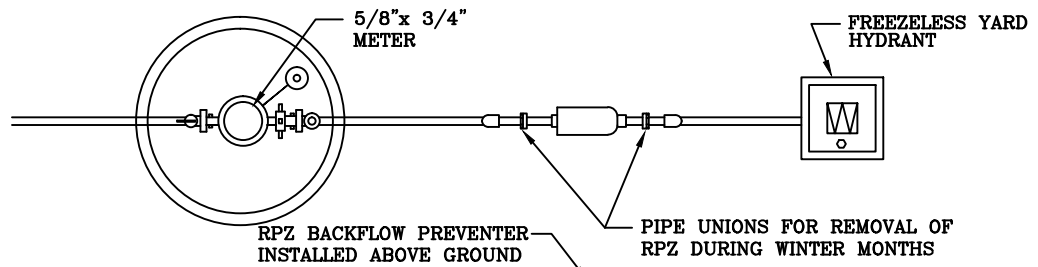


CONFIGURATION FOR PERMANENT SYSTEMS

REVISIONS				TYPICAL SEWER SUBTRACTION METER CONFIGURATION	DRAWING
NO.	DATE				W-06
ORIGINAL	12/01/06				
1	07/25/12				

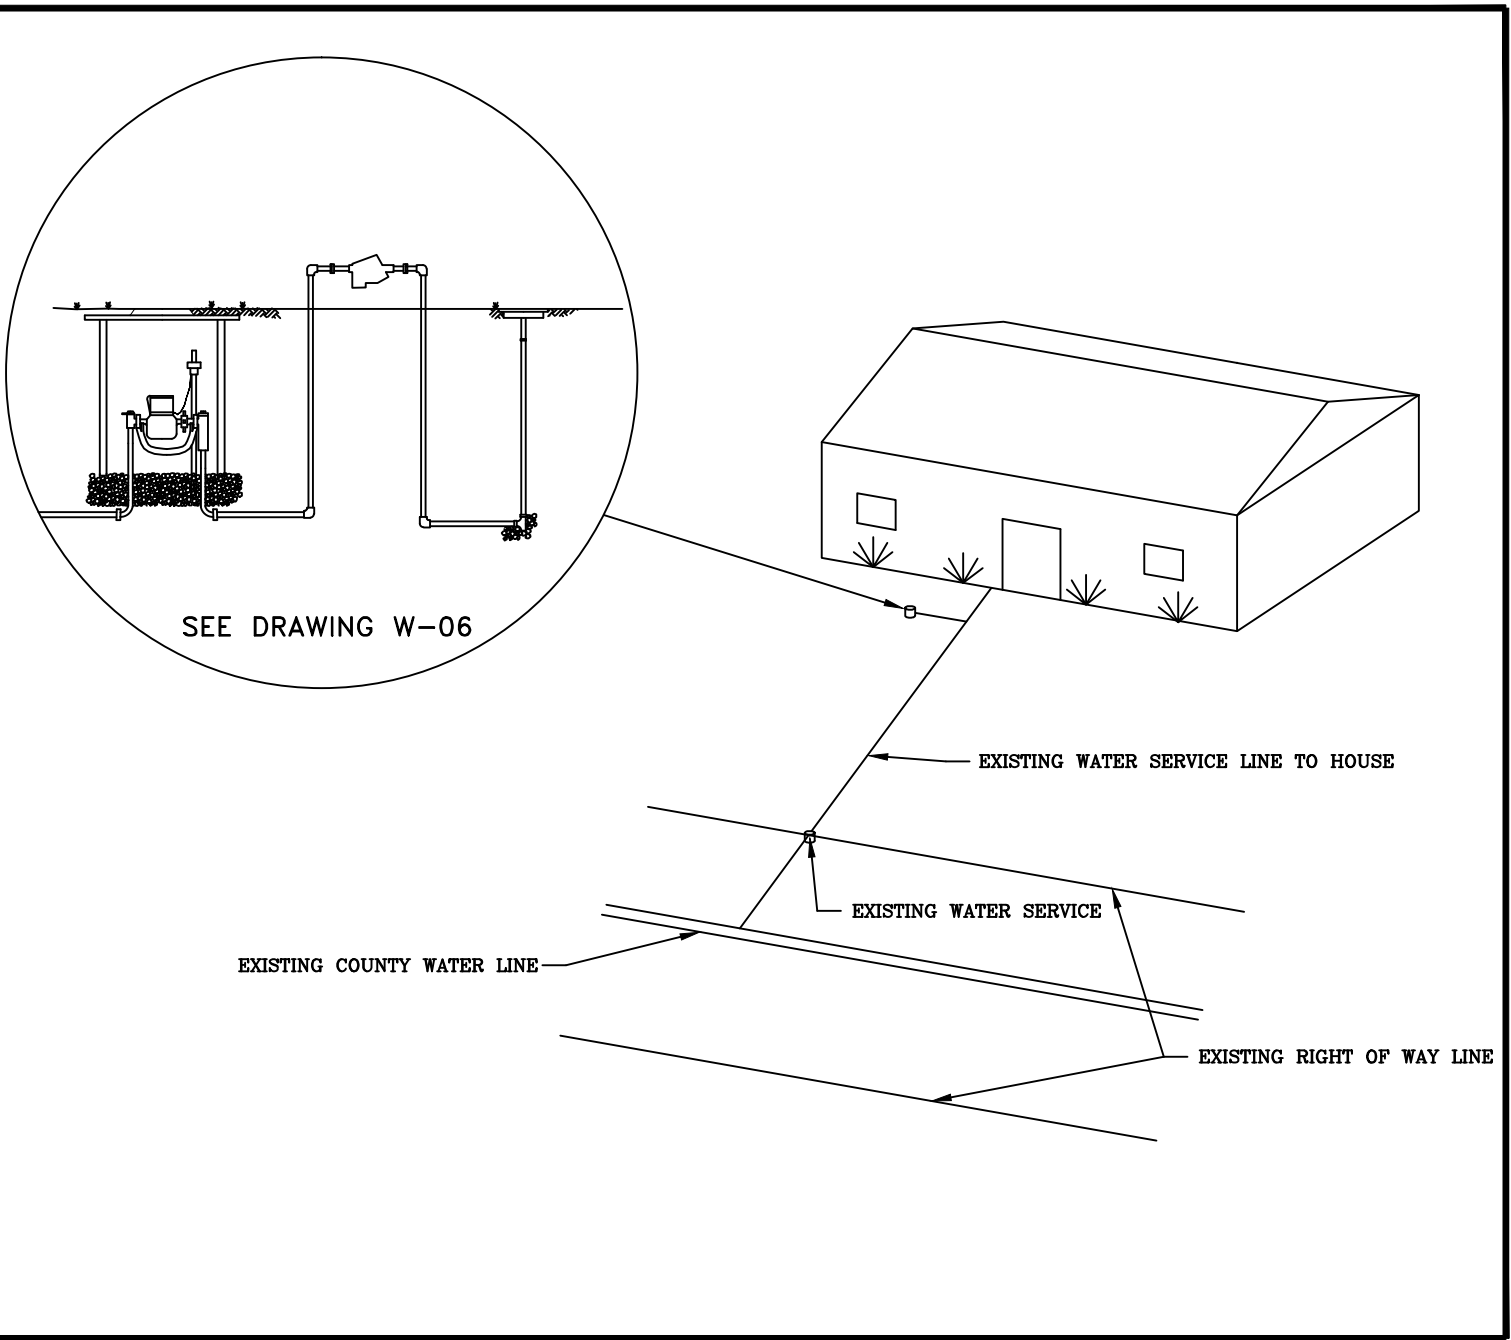

REVISIONS		NO.	DATE
		1	07/25/12


SEWER SUBTRACTION METER INSTALLATION		DRAWING W-07
---	--	-----------------

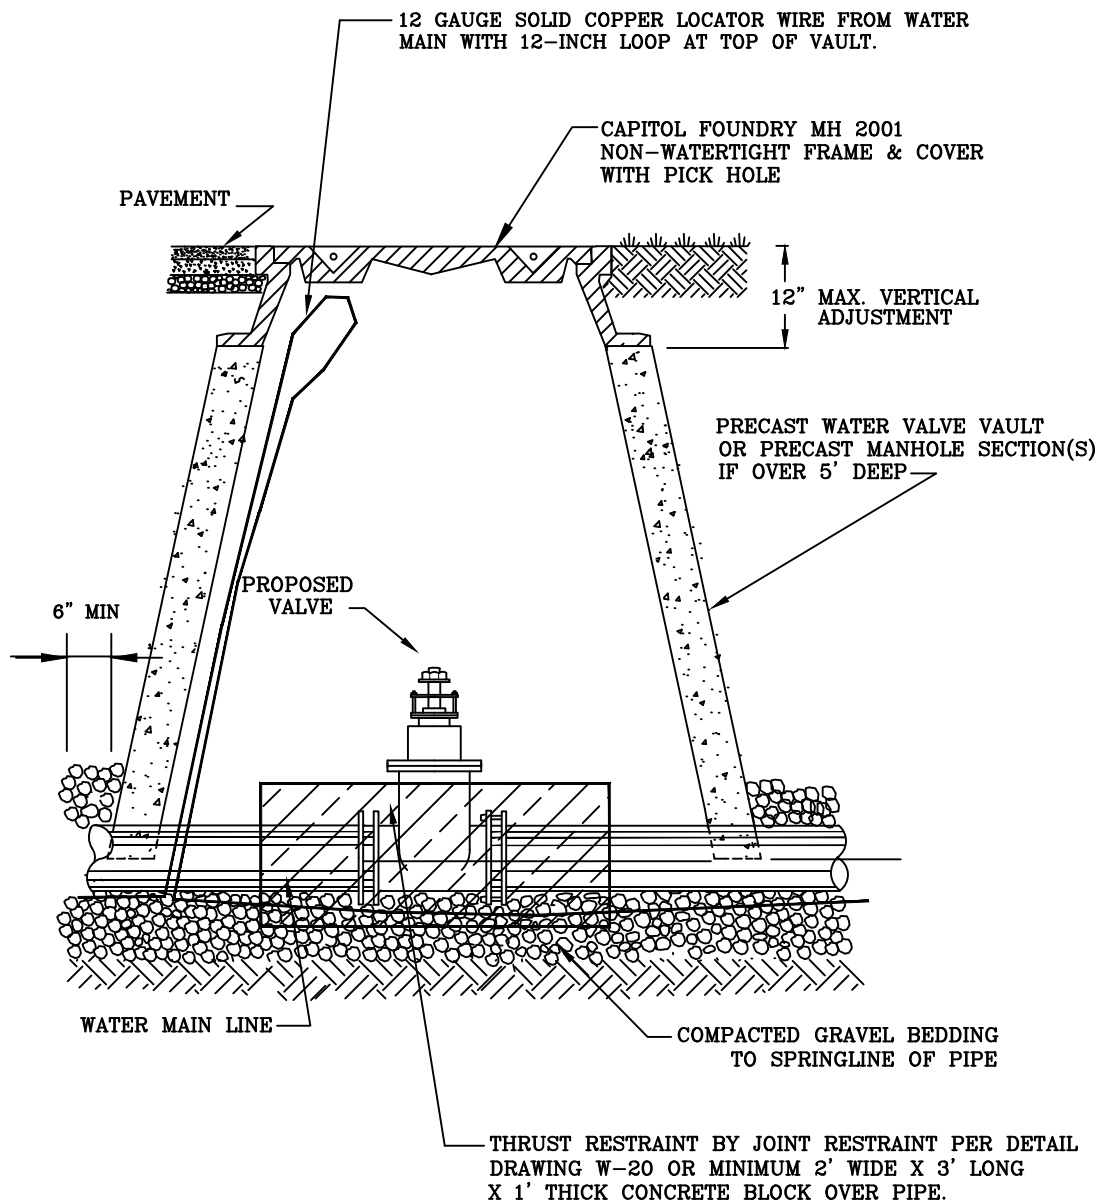

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	05/01/12		
2	07/17/18		


WATER LINE VALVE
 INSTALLATION

DRAWING
W-08

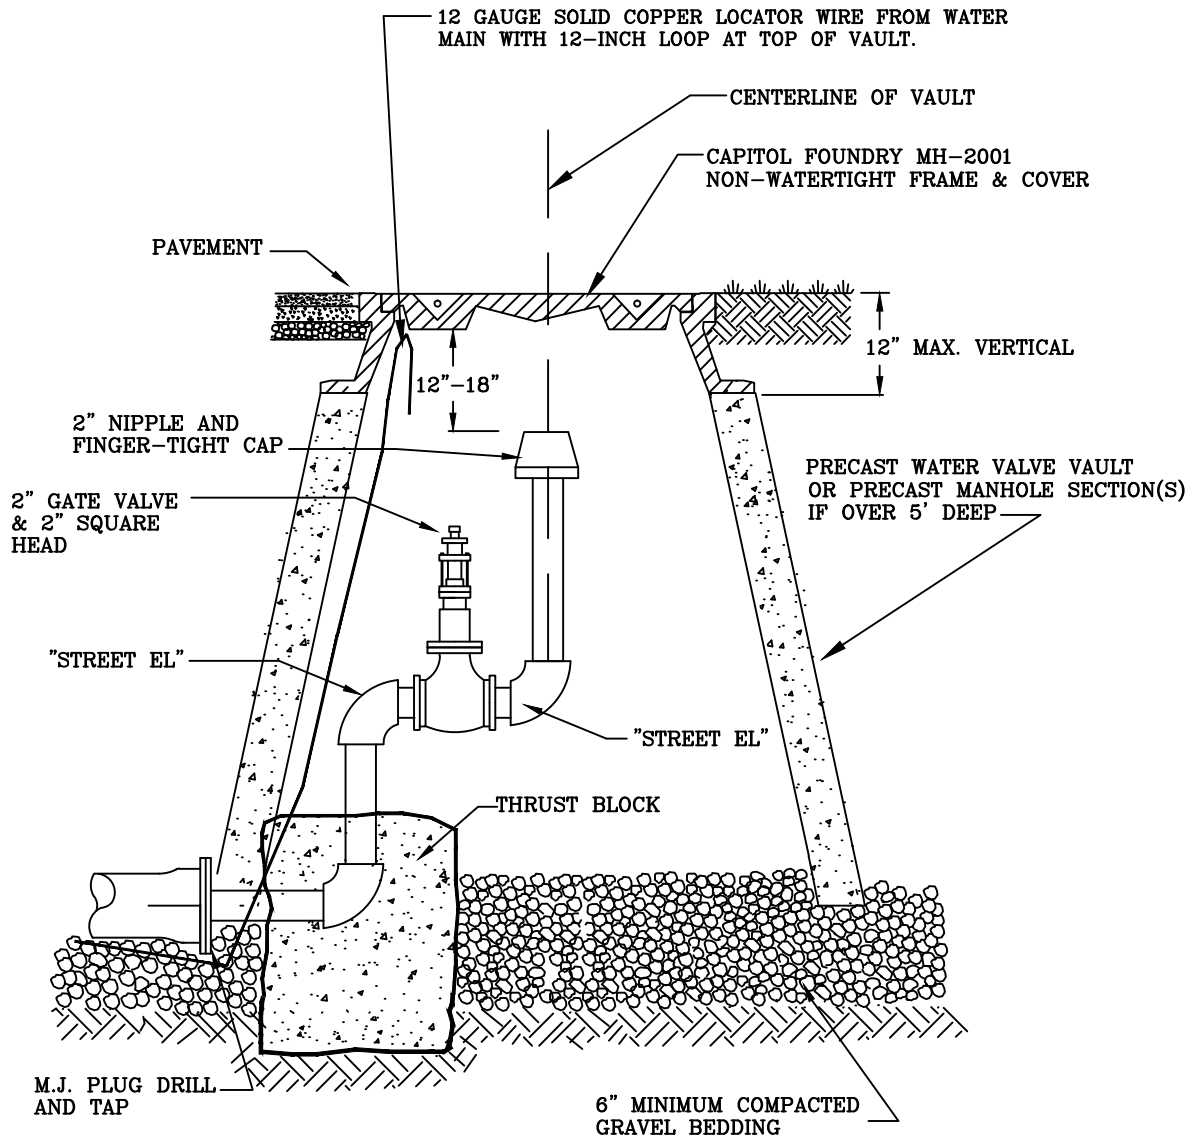

NOTE: FIRE HYDRANT ASSEMBLIES MAY BE USED AS PERMANENT END OF LINES.


REVISIONS		PERMANENT END OF LINE	DRAWING	
NO.	DATE		W-09	
ORIGINAL	12/01/06			
1	9/01/07			
2	5/01/12			

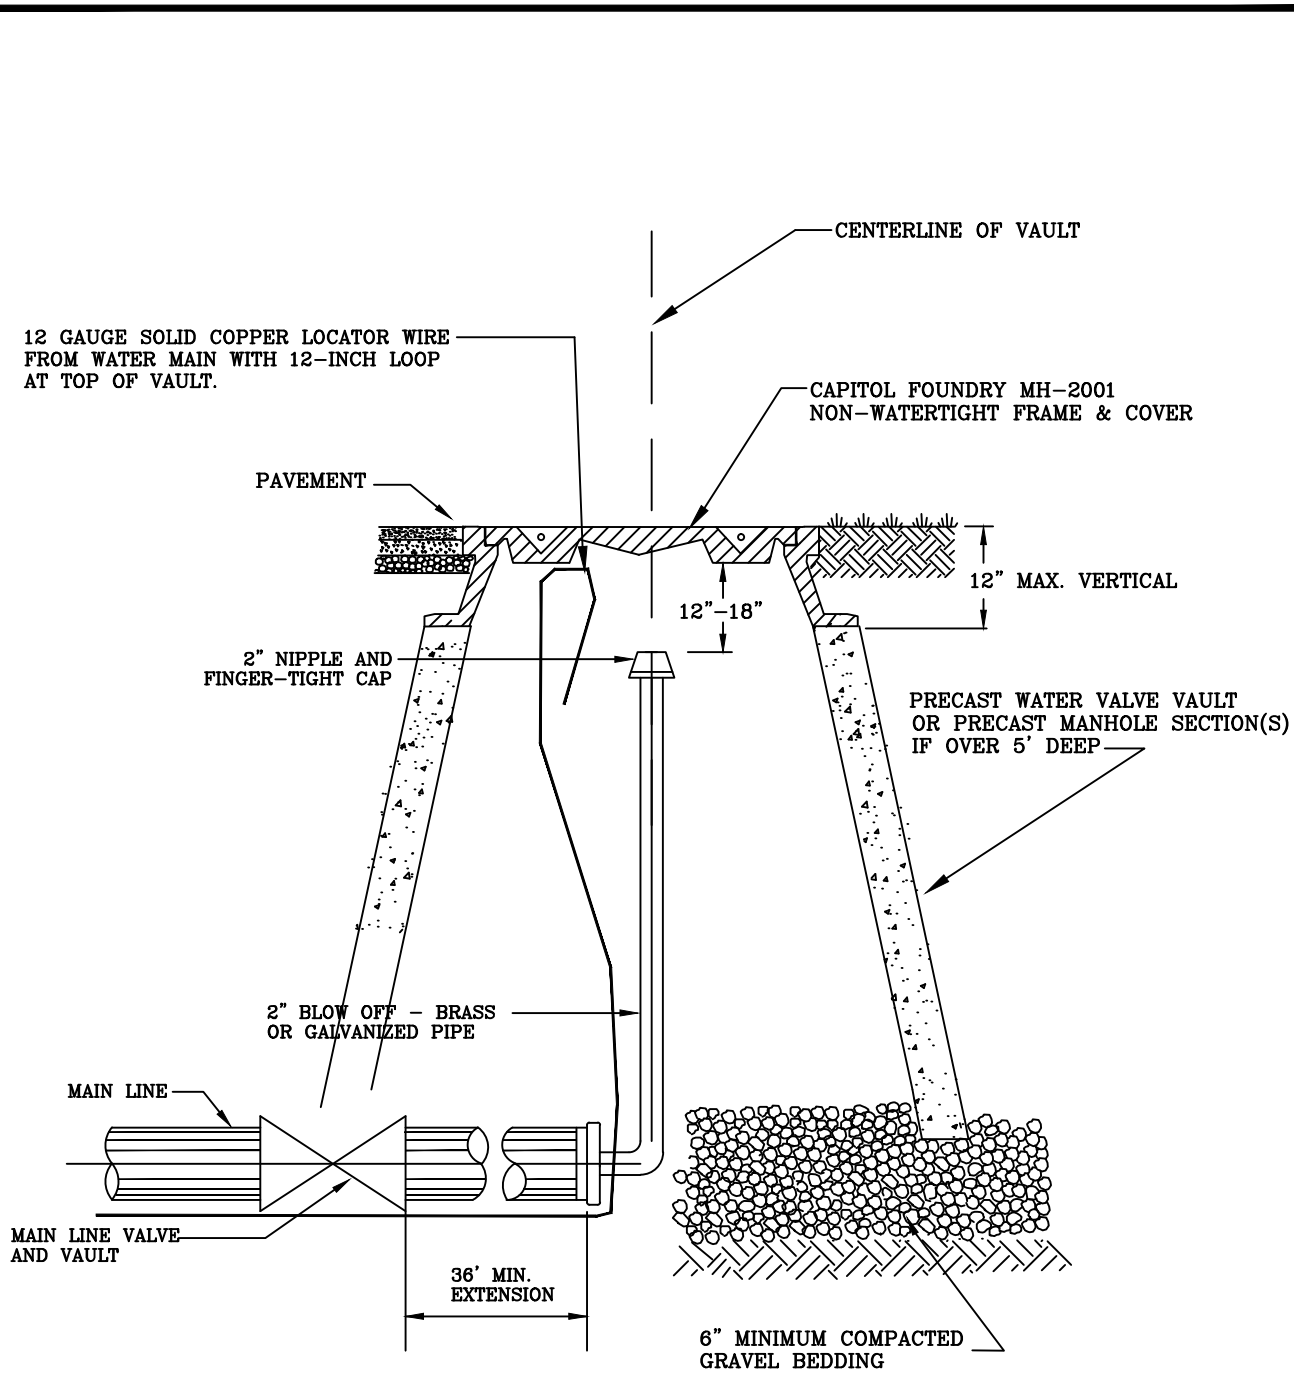

NOTE: PRESSURE TEST SHALL BE TO END OF BLOW-OFF ASSEMBLY

REVISIONS				DRAWING W-10
NO.	DATE			
ORIGINAL	12/01/06			
1	9/01/07			
2	5/01/12			


**BLOW-OFF ASSEMBLY
 FOR MAIN LINE
 TEMPORARY TERMINATION**

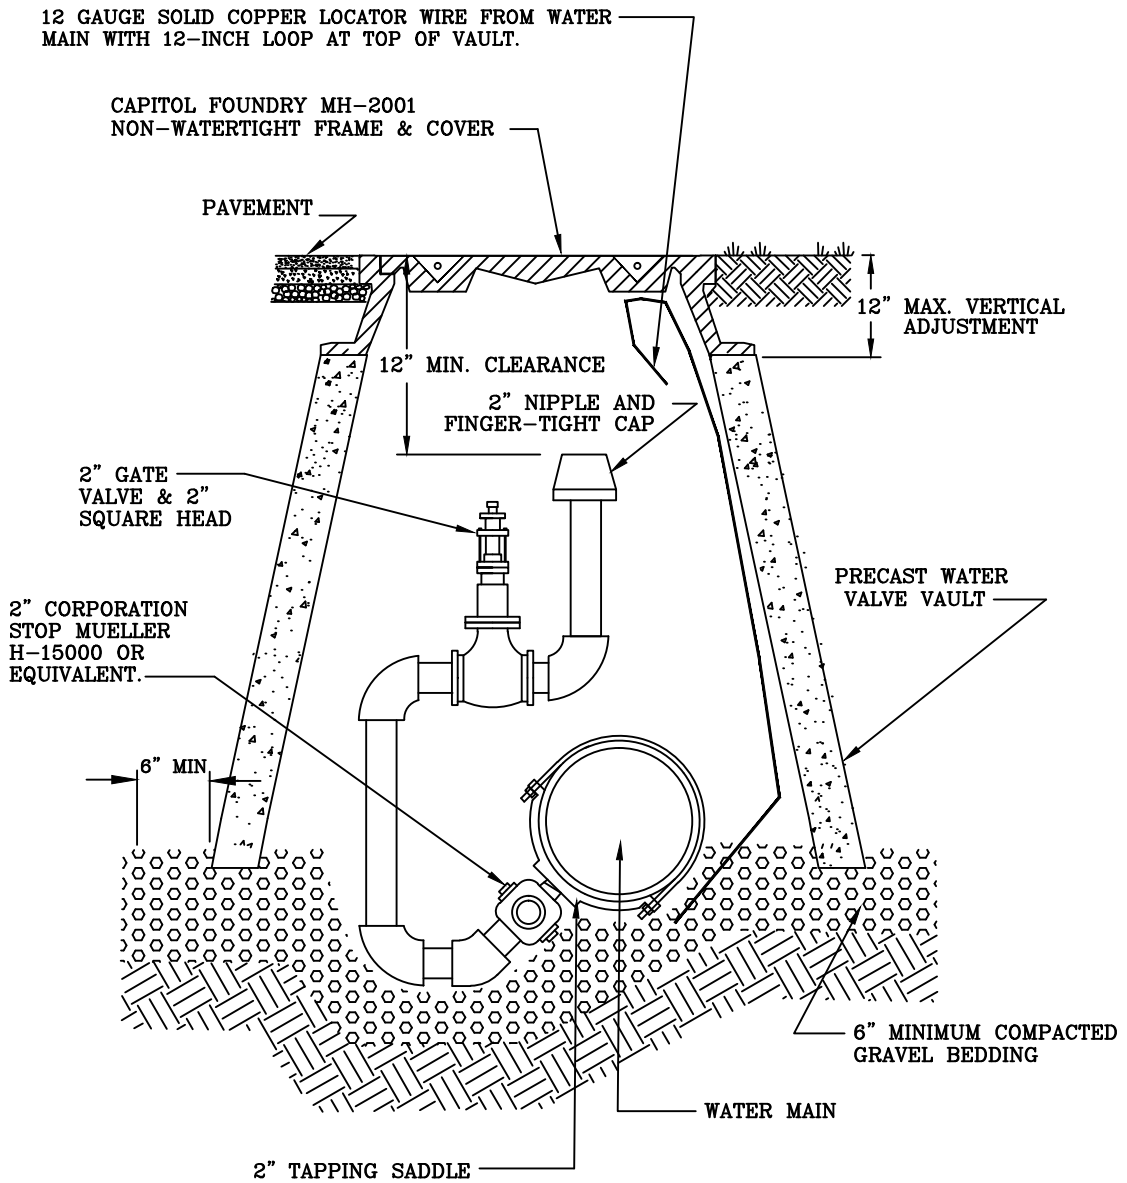

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	9/01/07		
2	5/01/12		

IN-LINE
 BLOW-OFF ASSEMBLY


DRAWING
W-11

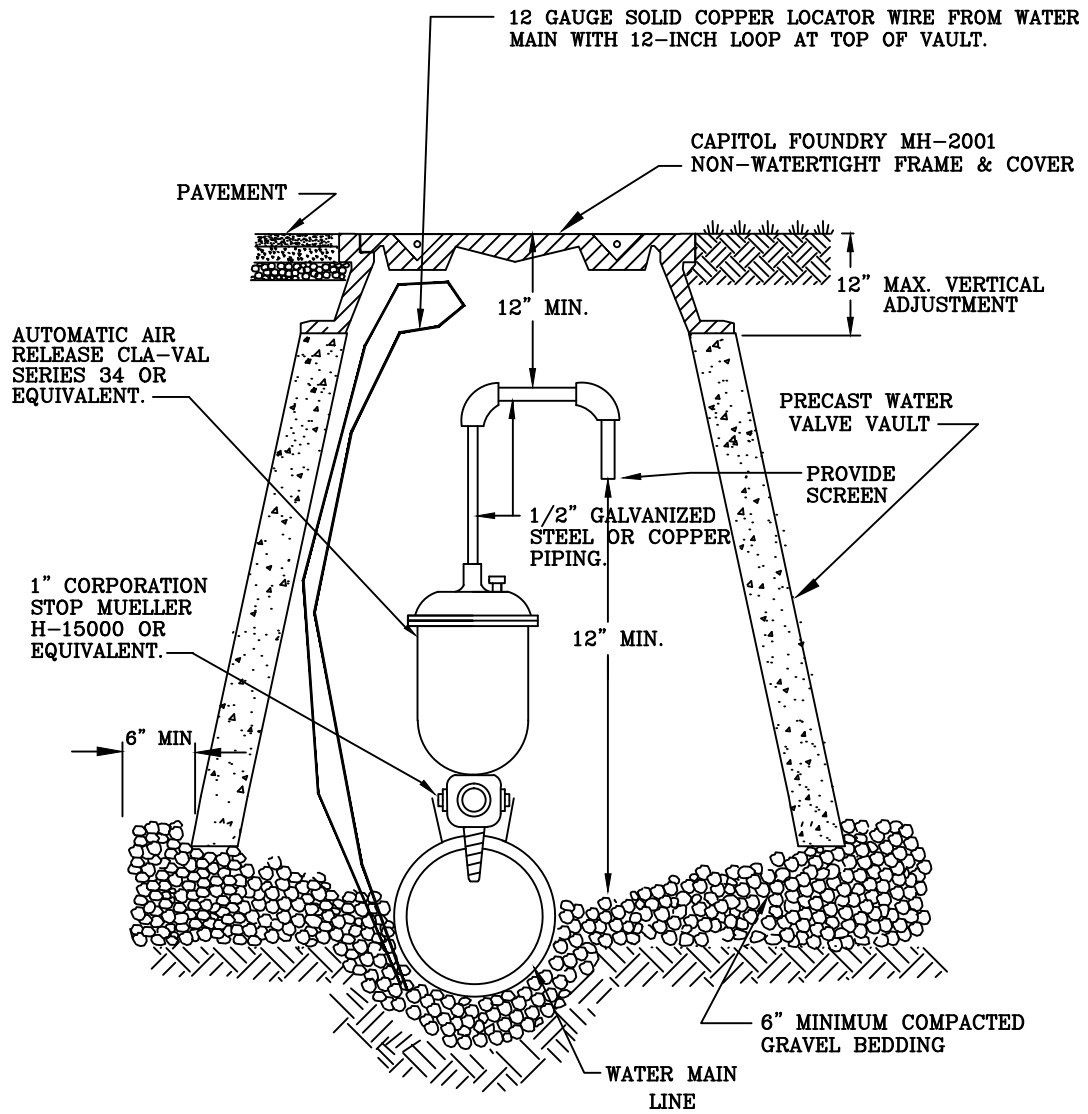

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	9/01/07		
2	5/01/12		

AUTOMATIC AIR
 RELEASE ASSEMBLY


DRAWING
W-12

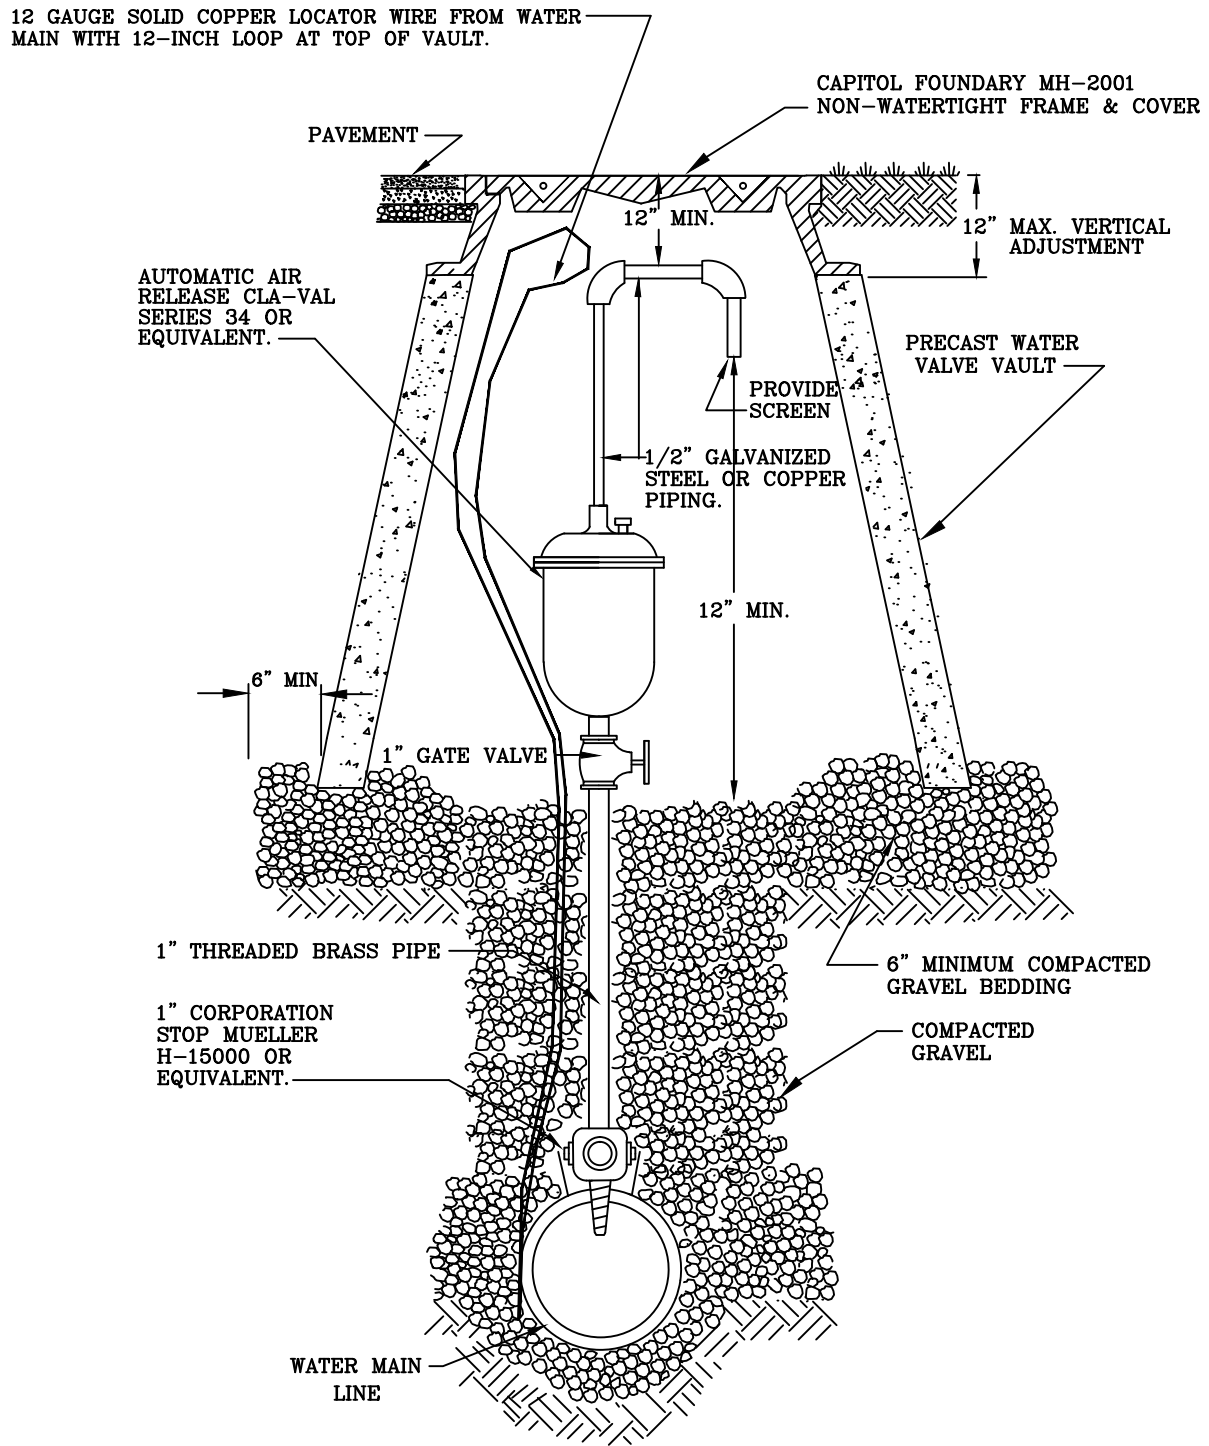

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	9/01/07		
2	5/01/12		

AUTOMATIC AIR
 RELEASE ASSEMBLY
 FOR DEEP WATER LINES

DRAWING
 W-13

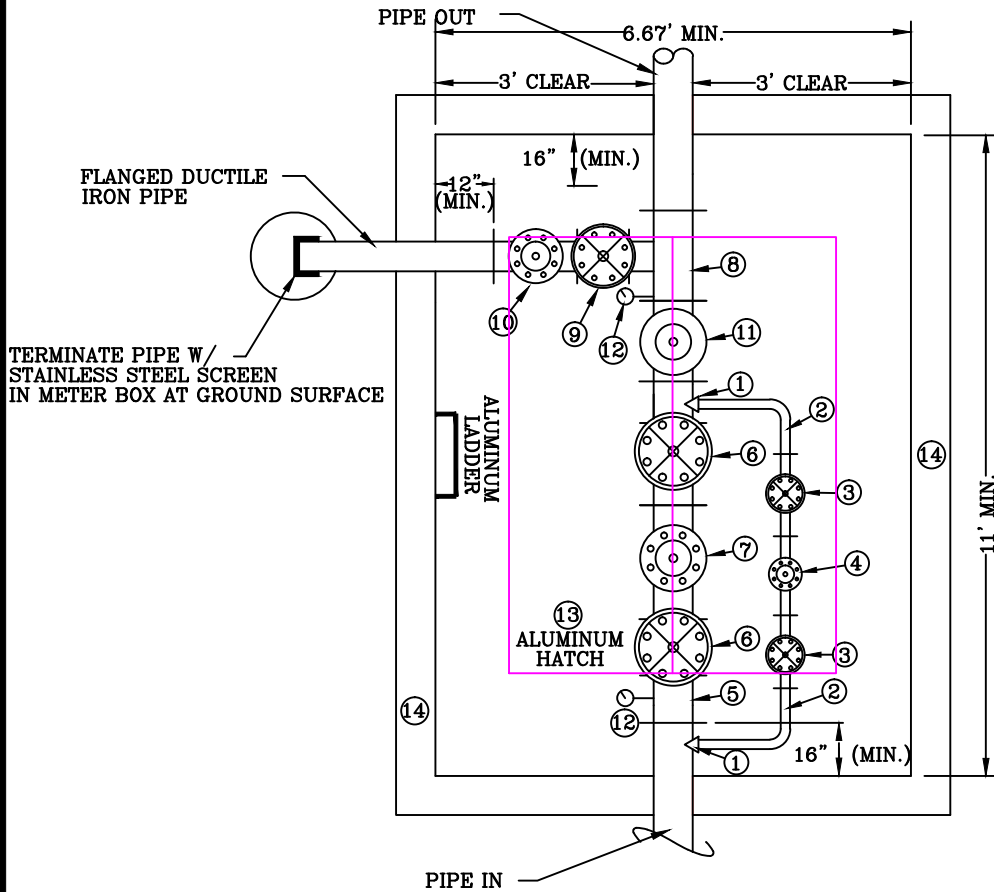


NOTES:
 ALL FITTINGS SHALL BE FLANGED OR COMPRESSION TYPE

- ① CORPORATION STOP
- ② 2" LOW-FLOW BYPASS LINE TYPE "K" COPPER
- ③ 2" NPT GATE VALVE
- ④ 2" FLANGED RATE OF FLOW/PRESSURE REGULATING VALVE (CLA-VAL MODEL 49-01) SET AT WORKING PRESSURE & 100 GPM
- ⑤ FLANGE x MECH. JOINT ADAPTOR (SEE NOTE BELOW)
- ⑥ FLANGE x FLANGE MAIN LINE GATE VALVE
- ⑦ FLANGE x FLANGE MAIN LINE PRESSURE REGULATING VALVE (CLA-VAL MODEL 690-01) SET AT 3 psi LESS THAN #4
- ⑧ FLANGE x FLANGE MAIN LINE REDUCING TEE
- ⑨ FLANGE x FLANGE GATE VALVE, ONE SIZE LESS THAN MAIN LINE
- ⑩ FLANGE x FLANGE PRESSURE RELIEF VALVE, ONE SIZE LESS THAN MAIN LINE (CLA-VAL MODEL 650-01) SET AT 5 psi GREATER THAN #4
- ⑪ MAIN LINE "TURBO" TYPE WATER METER
- ⑫ LIQUID FILLED PRESSURE GAUGE
- ⑬ 48"x 72" H2O TRAFFIC RATED ALUMINUM ACCESS HATCH (BILCO JD-3 H2O) OR EQUAL
- ⑭ PRE-CAST REINFORCED CONCRETE VAULT W/ 6" MIN. WALLS, TOP, AND BOTTOM

REVISIONS		MAIN LINE PRESSURE-REDUCING VALVE ASSEMBLY	DRAWING	
NO.	DATE		W-14	
ORIGINAL	12/01/06			
1	07/25/12			

NOTE:


TO BE USED WHEN STANDARD VAULT CONSTRUCTION EXCEEDS MAXIMUM VERTICAL HEIGHT OF 5'.

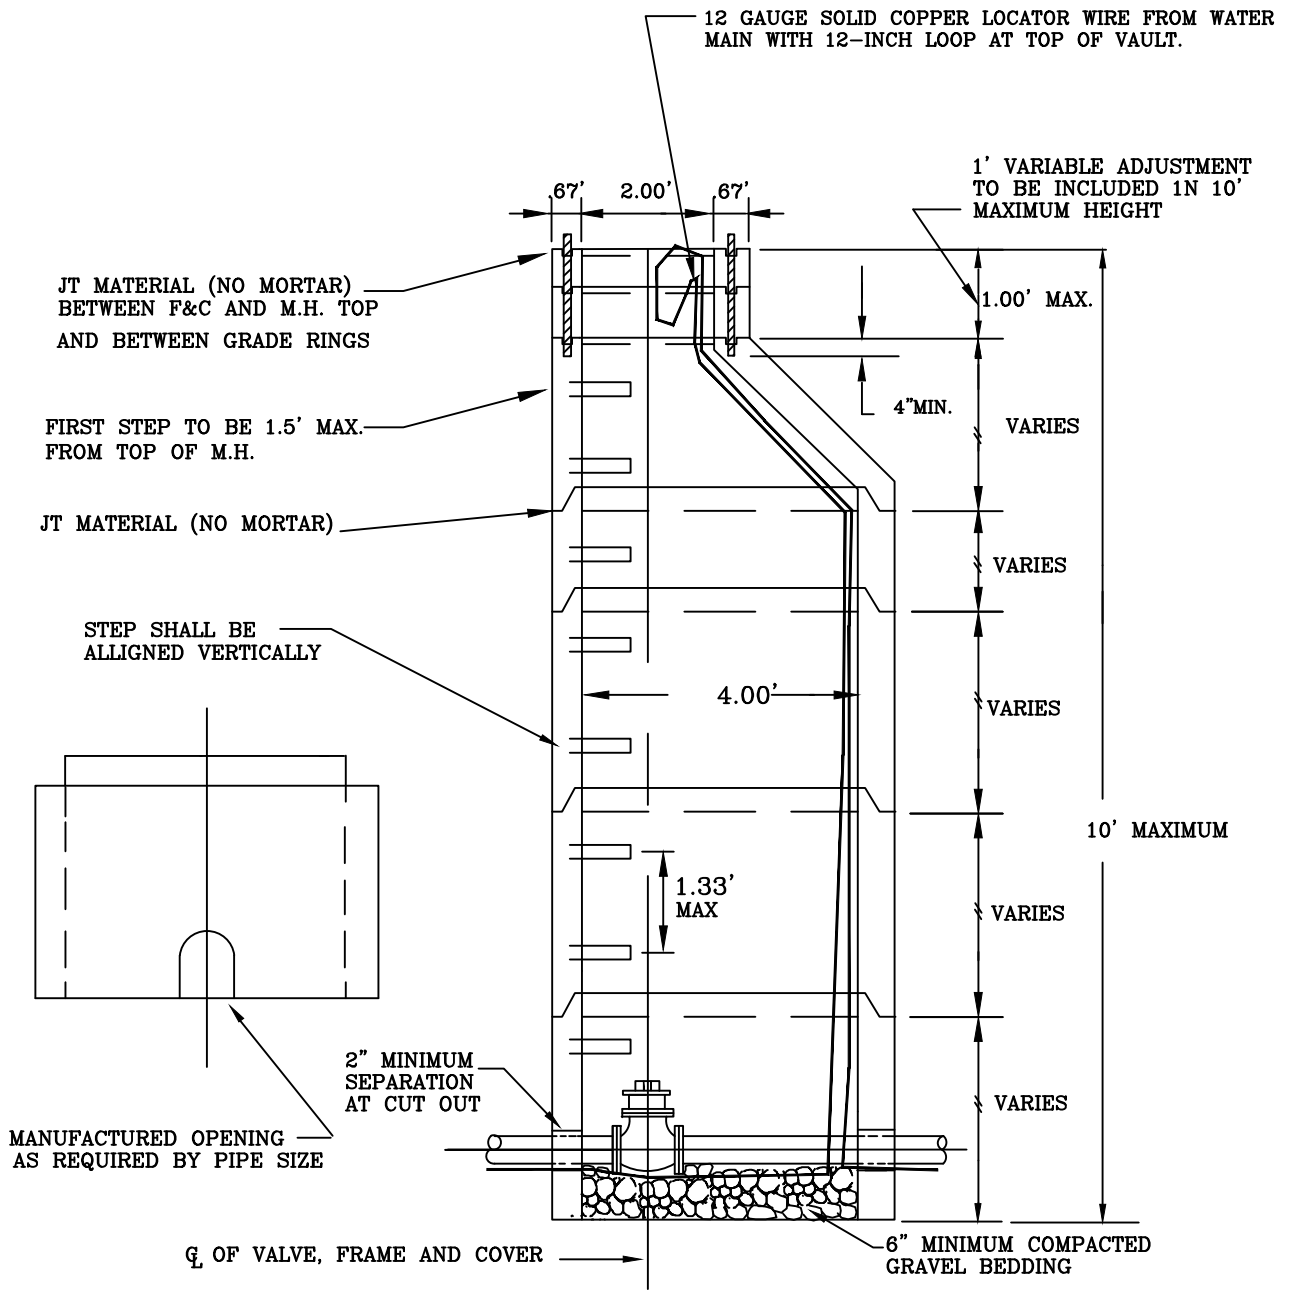

REVISIONS			
NO.	DATE		
ORIGINAL	12/01/06		
1	5/01/12		

ALTERNATE VALVE
 VAULT (MANHOLE)


DRAWING
W-15

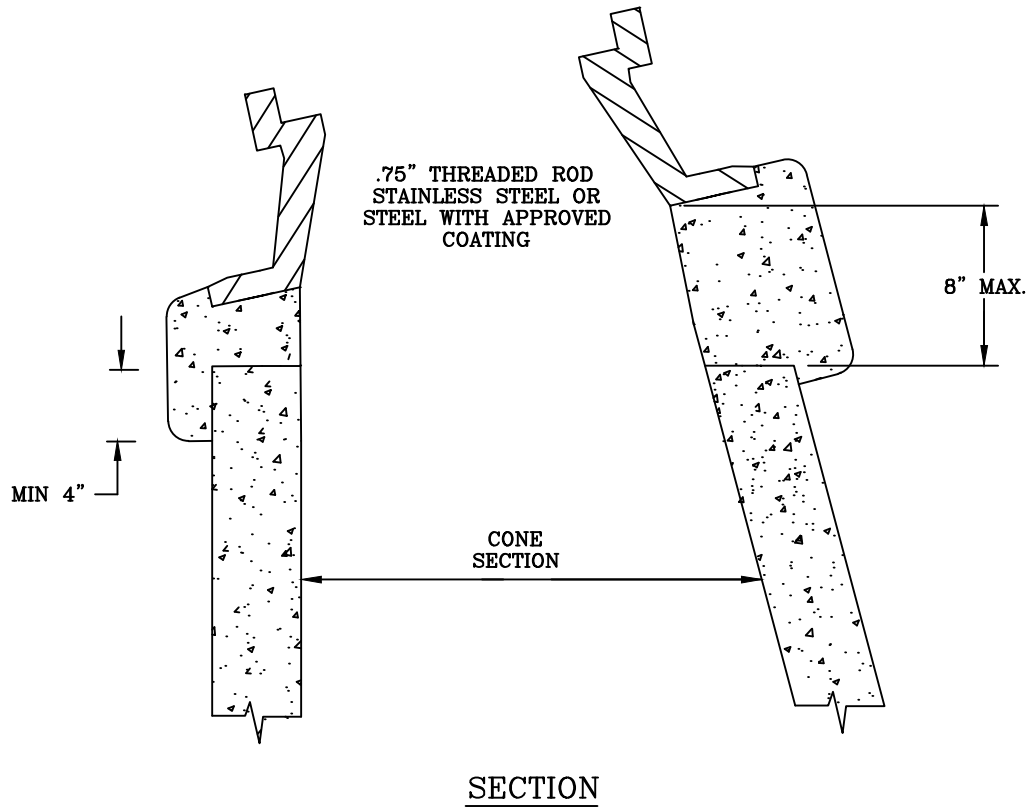

NOTE:


- 1 USE MODERATELY STIFF MIX OF NON SHRINK CEMENT, SAND AND 1/2" AND LESS DIAMETER GRAVEL WITH 28 DAYS, STRENGTH AT 3,000 P.S.I.
- 2 MIX IS TO BE FORCED INTO ALL GROOVES AND UNDER FLANGE OF FRAME AND LEFT AT OR ABOVE TOP OF FLANGE.
- 3 MAX. OF 4 BRICK OR CONCRETE BLOCKS TO BE USED FOR GRADE CONTROL.
- 4 DO NOT BACKFILL AROUND FRAME AND COVER, FOR 48 HOURS AFTER CON. IS PLACED. THE USE OF HIGH STRENGTH CONCRETE WOULD REDUCE TIME TO (24HRS).
- 5 RESTRICT TRAFFIC LOAD FOR MIN. 24 HOURS.

REVISIONS				INSTALLATION DETAIL FOR ALL FRAMES AND COVERS	DRAWING
NO.	DATE				W-16
ORIGINAL	12/01/06				
1	07/17/18				

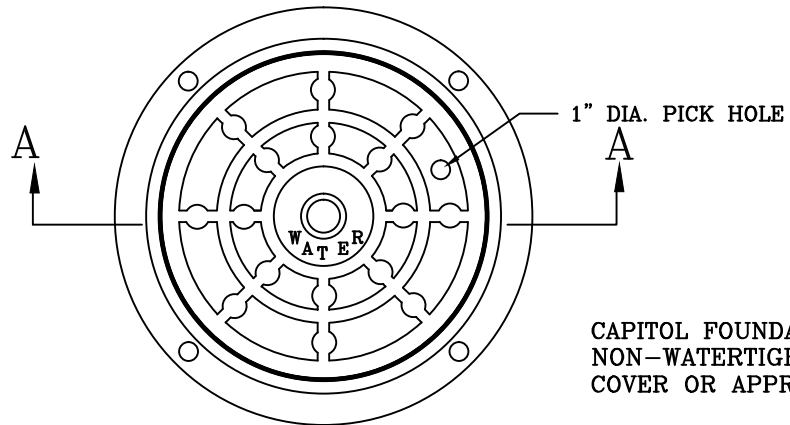

CAPITOL FOUNDARY MH-2001
 NON-WATERTIGHT FRAME &
 COVER OR APPROVED EQUAL


PLAN

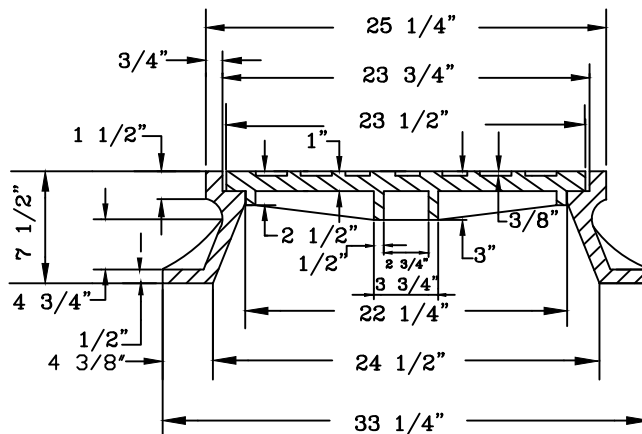

REVISIONS		MANHOLE FRAME AND COVER	DRAWING
NO.	DATE		W-17
ORIGINAL	12/01/06		

NOTES:



- (1) MAIN BODY OF HYDRANT MUST BE PAINTED ENTIRELY RED.
- (2) FIRE HYDRANT TO BE INSTALLED AT ROAD RIGHT-OF-WAY LINE OR EASEMENT LINE.
- (3) AREA AROUND HYDRANT AT A RADIUS OF 4' TO BE APPROXIMATELY LEVEL AND UNOBSTRUCTED.
- (4) "OUT OF SERVICE" RING SHALL BE PLACED UNDER 4 1/2" NOZZLE OF NEWLY INSTALLED FIRE HYDRANTS. PLASTIC BAGS SHALL NOT BE PLACED OVER HYDRANTS.

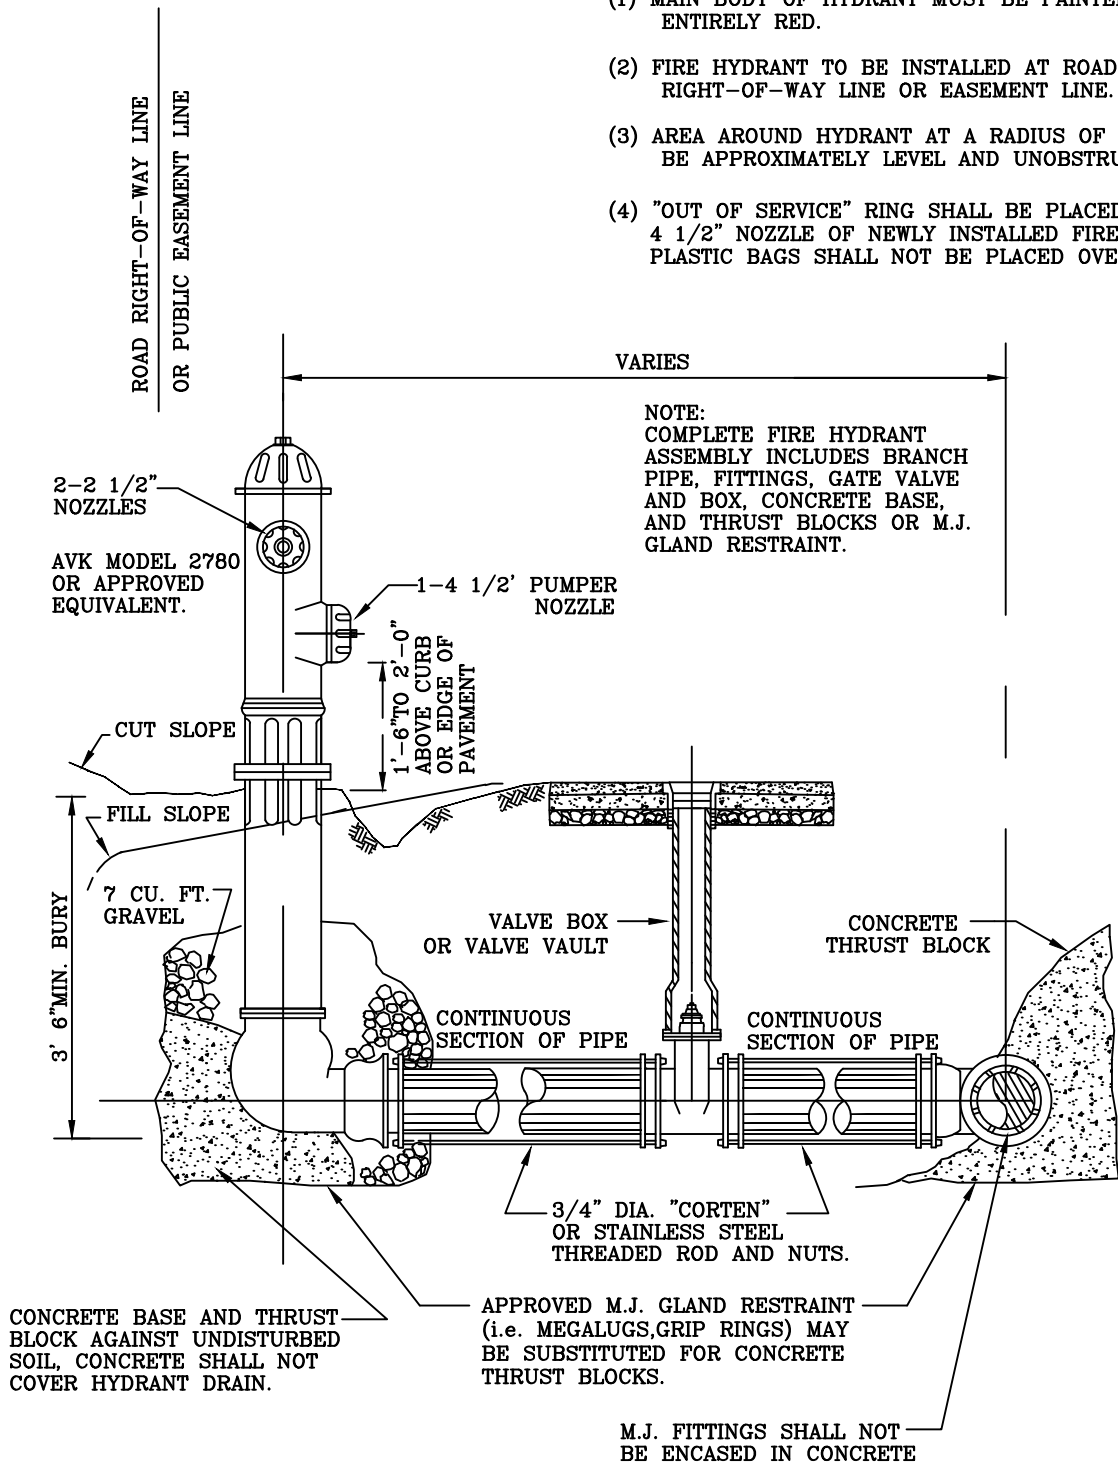


REVISIONS	
NO.	DATE
ORIGINAL	12/01/06
1	10/25/07
2	07/25/12

FIRE HYDRANT
 ASSEMBLY

DRAWING
W-18

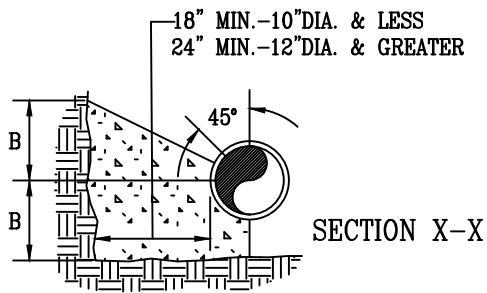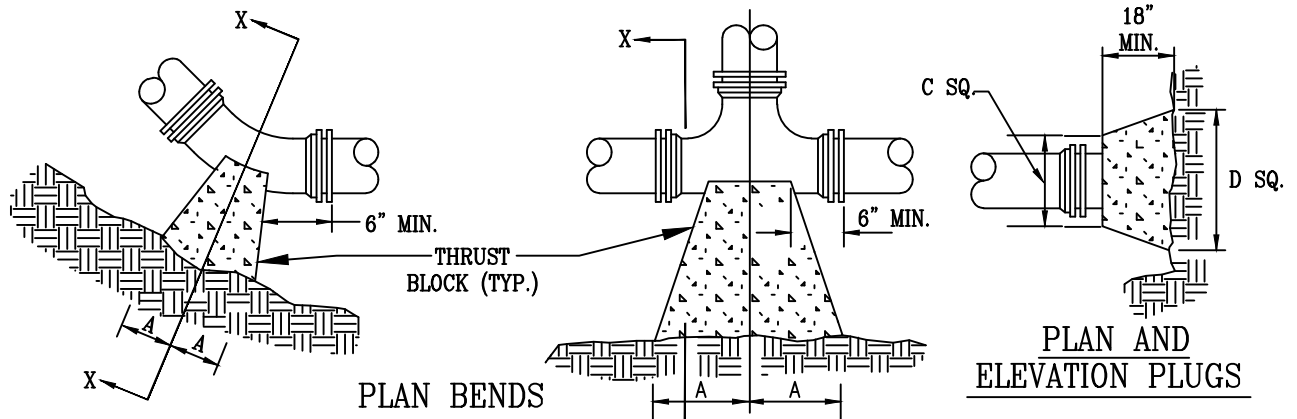

BENDS AND TEES

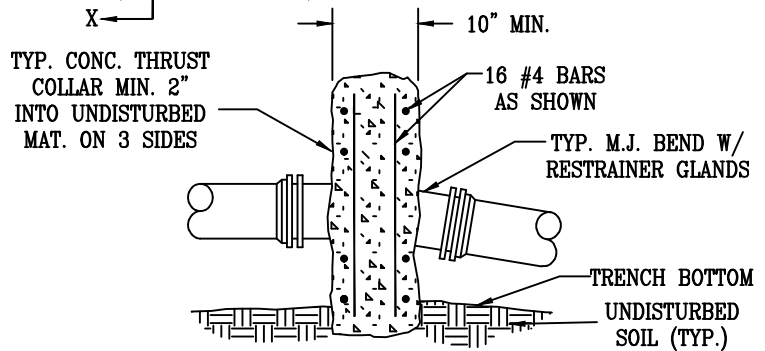

SECTION OF VERTICAL BEND

NOTES:

1. FOR VERT. BEND DOWN IN EXCESS OF 11 1/4" BEND, ANCHORAGE SHALL BE DESIGNED BY ENGINEER.
2. FOR VERT. BEND UPWARD, BLOCKING TO BE SIMILAR TO THAT FOR HORIZ. BEND.
3. GLANDS & BOLTS SHALL BE PROTECTED FROM CONC. BY PLASTIC SHEETING WHEN POURING THRUST BLOCKS.
4. ALL THRUST BLOCK & SUPPORT CONC. SHALL BE 3000 PSI READY MIX CONC.
5. THRUST BLOCKS WITH "B" DIMENSION GREATER THAN 30" SHALL HAVE THE RESTRAINED PIPE INSTALLED WITH A MINIMUM OF 4' OF COVER.
6. SEE DRAWING W-06 FOR THRUST BLOCK REQUIREMENTS FOR GATE VALVES.

PRESSURE = 200 psi BEARING = 2000 psf FACTOR OF SAFETY = 1.5

PIPE SIZE	90° BEND		45° BEND		22 1/2° BEND		11 1/4° BEND		TEE		PLUG	
	A	B	A	B	A	B	A	B	A	B	C	D
4"	8"	12"	8"	8"	6"	6"	6"	6"	11"	9"	10"	6"
6"	18"	12"	8"	10"	8"	8"	8"	8"	11"	10"	12"	18"
8"	18"	13"	10"	10"	8"	8"	8"	8"	11"	12"	12"	24"
10"	20"	16"	12"	14"	8"	12"	8"	12"	14"	16"	16"	30"
12"	20"	16"	12"	14"	8"	12"	8"	12"	14"	16"	16"	30"
16"	26"	20"	16"	18"	11"	13"	11"	13"	18"	20"	20"	36"
24"	82"	42"	62"	30"	44"	22"	22"	16"	82"	42"	82"	42"
30"	185"	42"	100"	42"	52"	42"	40"	30"	185"	42"	185"	42"


REVISIONS		THRUST BLOCK CONSTRUCTION	DRAWING
NO.	DATE		W-19
ORIGINAL	12/01/06		
1	07/17/18		

FACTOR OF SAFETY = 1.5

PIPE SIZE	PIPE MAT'L	90° BEND	45° BEND	22 1/2° BEND	11 1/4° BEND	VALVE /PLUG	TEE BRANCH	REDUCER (NOTE 2)	VERT. 45°	VERT. 22 1/2°	VERT. 11 1/4°
6"	D.I.	28'	12'	6'	3'	38'	34'	20'	23'	11'	5'
8"	D.I.	37'	15'	7'	4'	51'	47'	21'	30'	15'	7'
10"	D.I.	45'	19'	9'	4'	61'	57'	20'	37'	18'	9'
12"	D.I.	53'	22'	11'	5'	73'	69'	38'	43'	21'	10'
6"	PVC	30'	12'	6'	3'	56'	38'	29'	35'	17'	8'
8"	PVC	40'	16'	8'	4'	74'	56'	31'	46'	22'	11'
10"	PVC	47'	20'	9'	5'	89'	82'	30'	56'	27'	13'
12"	PVC	56'	23'	11'	6'	106'	88'	56'	66'	32'	16'


1. ALL JOINTS SHALL BE RESTRAINED ON BOTH SIDES OF THE FITTING FOR THE LENGTH SHOWN UNLESS OTHERWISE INDICATED.
2. REDUCER IS ONE SIZE SMALLER THAN PIPE LISTED. RESTRAINED LENGTH IS UPSTREAM ON THE LARGE SIDE OF THE REDUCER.

REVISIONS				THRUST RESTRAINT OF PIPE JOINTS DESIGN LENGTHS	DRAWING W-20
NO.	DATE				
ORIGINAL	12/01/06				

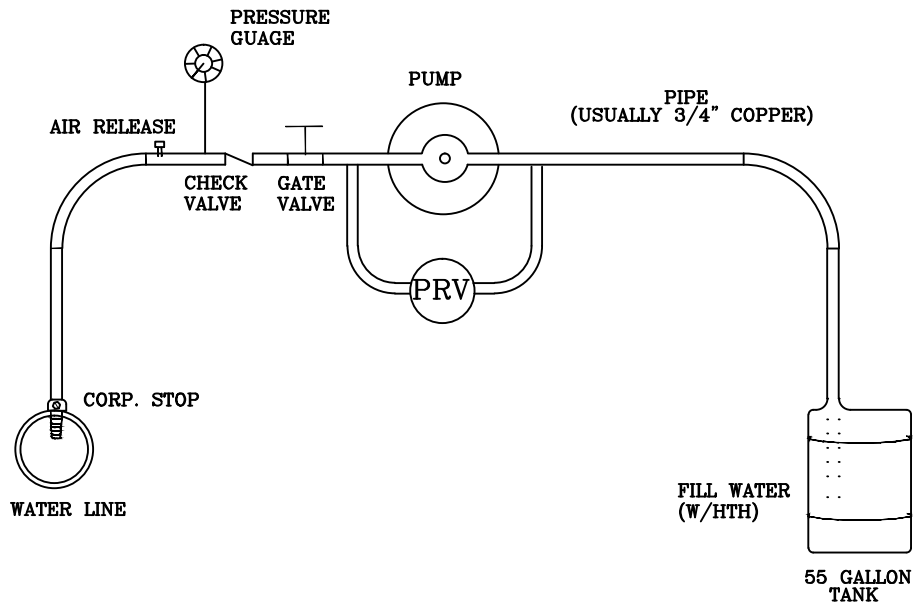


TYPICAL WATER PRESSURE TEST RIG

REVISIONS				TYPICAL WATER PRESSURE TEST RIG	DRAWING
NO.	DATE				W-21
ORIGINAL	12/01/06				

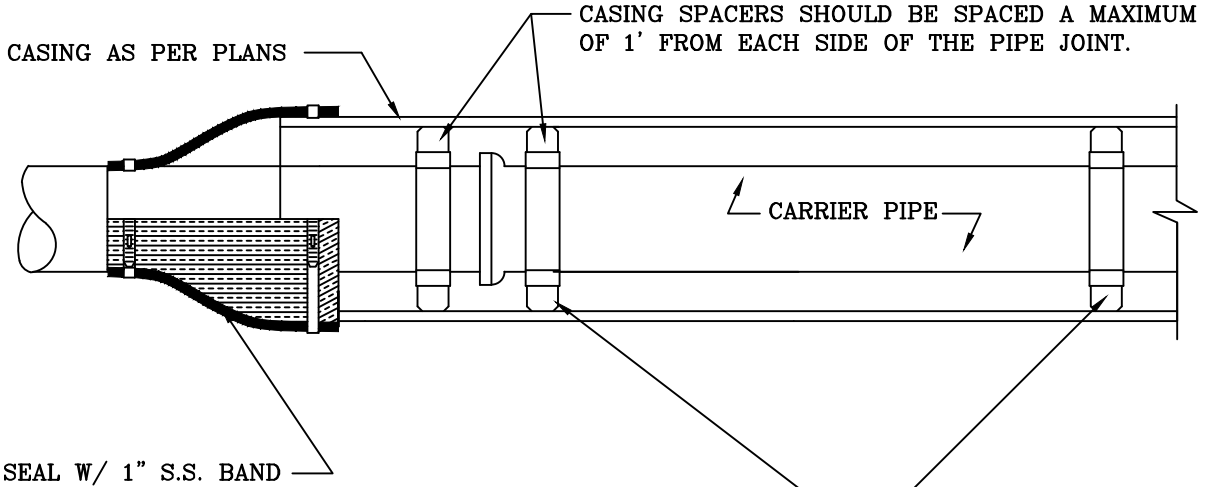

CASING SPACERS SHOULD BE SPACED A MAXIMUM OF 12' BETWEEN CASING SPACERS OR AS RECOMMENDED BY MANUFACTURER.
 MAXIMUM TOTAL FREE PLAY BETWEEN OUTSIDE OF SPACERS AND INSIDE OF CASING PIPE SHALL BE 1 INCH.

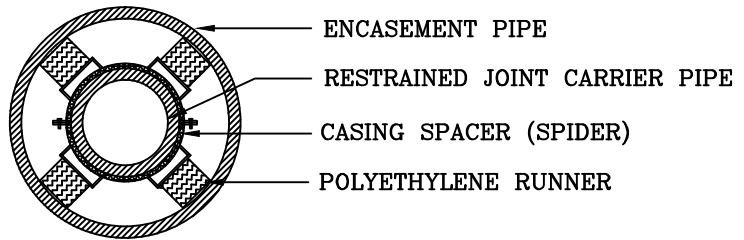

NOTE: A 1" DRAIN WILL BE REQUIRED ON THE LOWER END OF THE CASING IF THE CASING ENDS ARE SEALED WITH MORTER AND BRICK.

REVISIONS				PIPE SUPPORT IN CASING PIPE	DRAWING
NO.	DATE				W-22
ORIGINAL	12/01/06				